
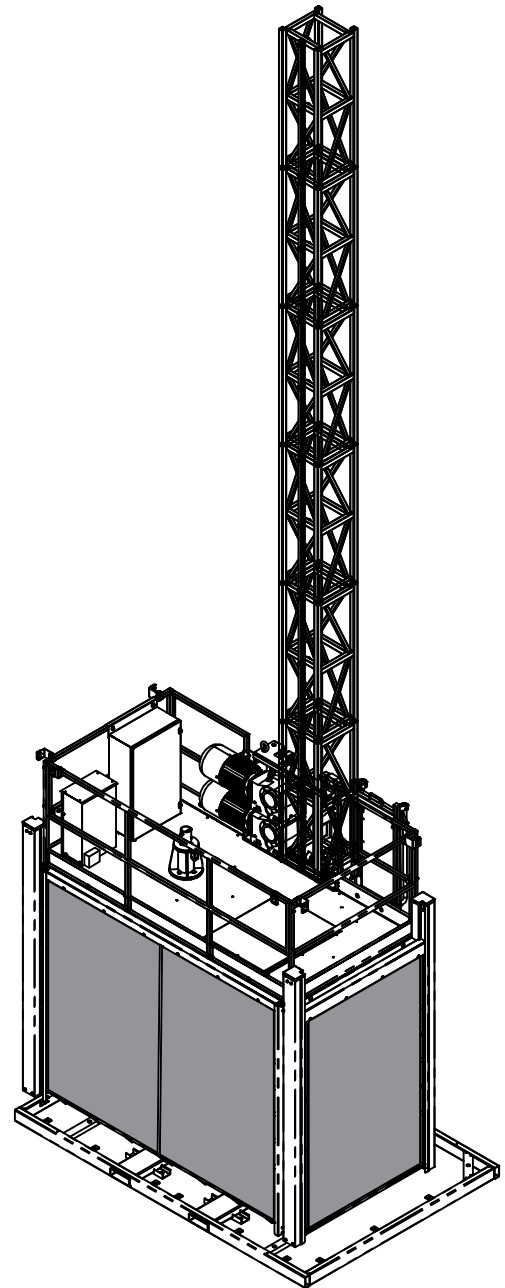


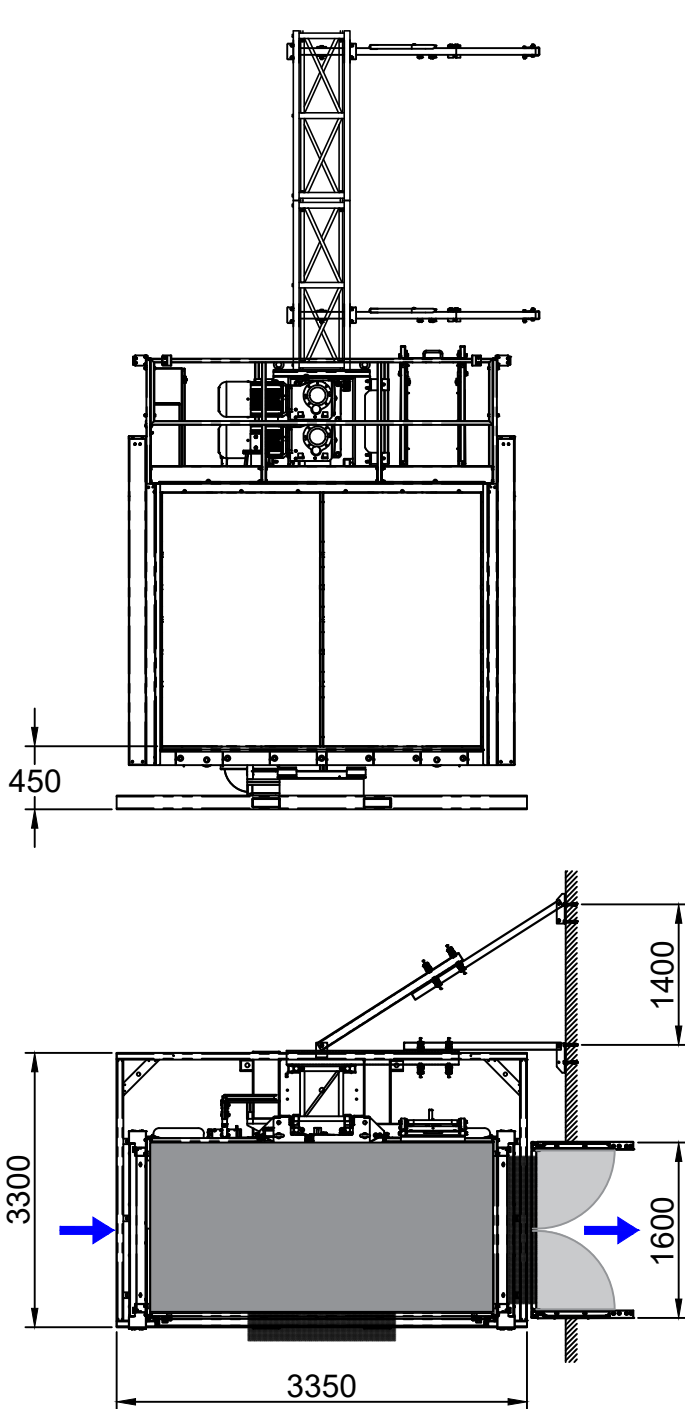

MABER Personal Hoist	Capacity range (kg)	Internal Platform Size (m)	Drop Ramp Size (m)	Loading height from Base (mm)	Power Outlet Required	Min Power Supply Cable (mm sq.)	Min Generator	Ground Footprint Required (m)	Min Penetration Size (m)	Mast Location	Bracing Interval (m)	Speed (m/min)
MBA1800	1800	1.5* x 3	1.5 x 0.3	450	50A 415V	Min 10mm ² cable 50A C/B	80kVA 415V	3.35 x 3.3*	3.1-3.7 x 2.8*	Left	7.0	43
MBA2000	2000	1.5* x 2.6-3.2	1.5 x 0.3	450	50A 415V	Min 16mm ² cable 50A C/B	120kVA 415V	3.35-3.5 x 3.3*	3.1-3.7 x 2.8*	Left / Right	7.0	43

*This measurement is parallel to the Building or Scaffold Edge

Ph: 13001HOIST | SYDNEY 244 Ingelburn Rd Leppington, NSW | MELBOURNE 34/B Maria Street Laverton North VIC | www.aussiehoist.com.au

Rev 2025/06B.