
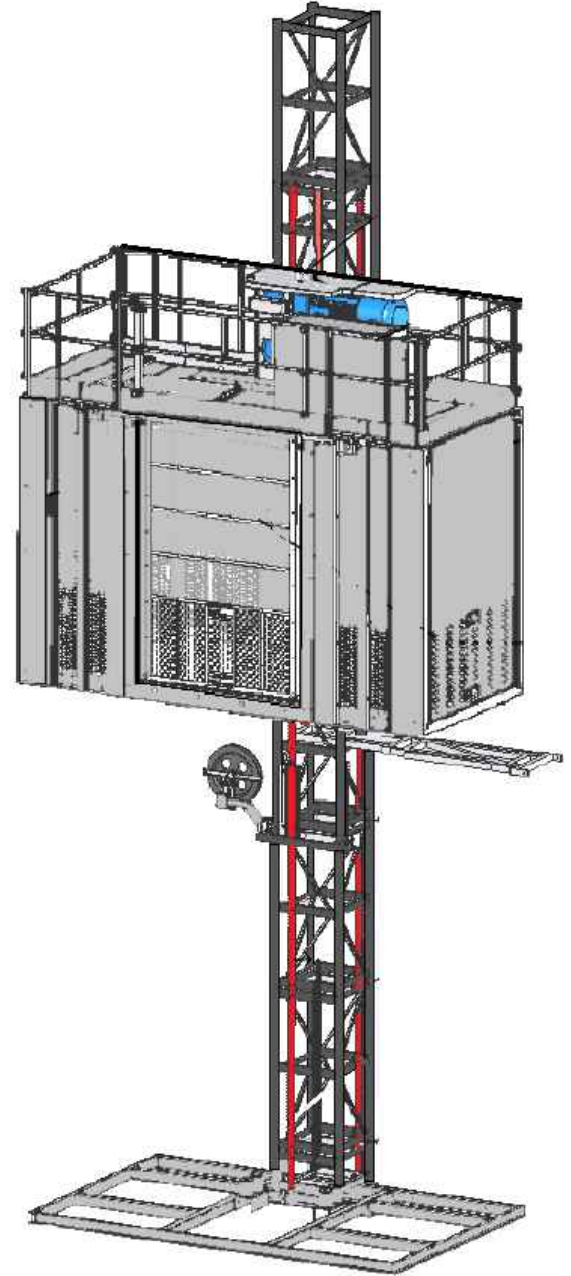
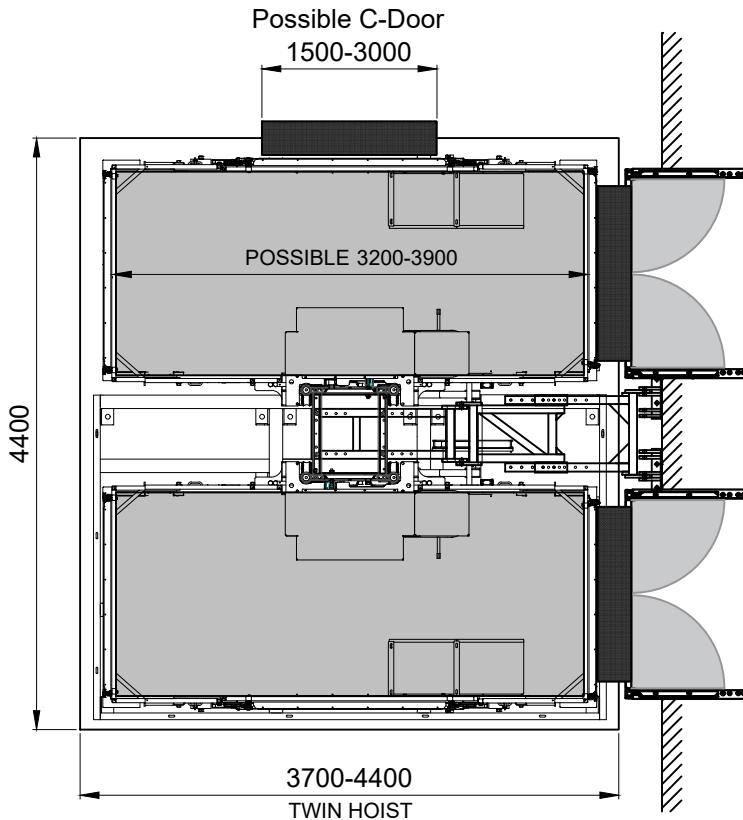


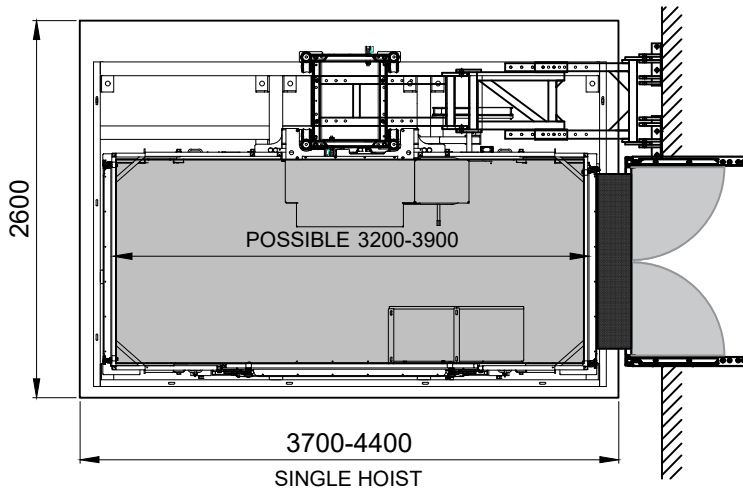

MS2237 Hoist	Capacity (T)	Internal Platform Size (m)	Drop Ramp Size (m)	Loading Height from Base (mm)	Power Outlet Required	Power Circuit Required	Min Generator Size	Ground Footprint Required (m)	Min Penetration Size (m)	Transport Height (m)	Speed (m/min)	(Optional) 3rd Door size (mm)
SINGLE	2-2.7	1.5* x 3.2-3.9	1.5 x 0.3	500	100A 415V Isolator	Min 32mm ² cable 100A C/B	150KVA 415V	3.5-4.2 x 2.6*	3.7-4.4 x 2.8*	3.4	60-87	1.5-3.0
TWIN	2 x 2-2.7	2 x 1.5* x 3.2-3.9	2 x 1.5 x 0.3	500	2 x 100A 415V Isolators	2 x Min 32mm ² cable 100A C/B	200KVA 415V	3.5-4.2 x 4.2*	3.7-4.4 x 4.4*	3.4	60-87	1.5-3.0
POD	1.6	2* x 3.6 only	2 x 0.3	500	100A 415V Isolator	Min 32mm ² cable 100A C/B	150KVA 415V	3.85 x	4.1x3.1* 2.8*	3.4	60-87	1.5-3.0

*This measurement is parallel to the Building or Scaffold Edge

Rev 202506.

Ph: 13001HOIST | SYDNEY 244 Ingleburn Rd Leppington, NSW | MELBOURNE 34/B Maria Street Laverton North VIC | www.aussiehoist.com.au